

PROJECT NUMBER: 30160-09-08173
PAGE: 1 of 4
DATE: September 4, 2009

662 Cromwell Avenue Telephone : (651) 645-3601
 Saint Paul, MN 55114 Toll Free : (888) 645-TEST
 USA Telefax : (651) 659-7348
 Website : www.storksmt.com

Investigative Chemistry Geotechnical Construction Materials
 Non Destructive Testing Failure Analysis Product Evaluation
 Metallurgical Analysis Materials Testing Welder Qualification

**SOUND TRANSMISSION CLASS TESTING
 LEDGE STONE PANEL**

Prepared for:
FANCON, INC
Attn: Mr. Don Elliott
6111 West Highway 13
Savage, MN 55378

Client Reference Number: 134966

Prepared By:




Mathew N. Botz
Project Manager
Product Testing Department
(651) 659-7353

Reviewed By:



Kyle T. Hall
Sr. Engineering Technician
Product Testing Department

The test results contained in this report pertain only to the samples submitted for testing and not necessarily to all similar products.

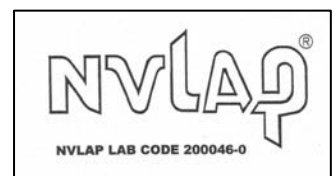

PROJECT NUMBER: 30160-09-08173

PAGE: 2 of 4

DATE: September 4, 2009

AIRBORNE SOUND TRANSMISSION LOSS (STC) ASTM E90**INTRODUCTION:**

This report presents the sound transmission results conducted on a Ledge Stone concrete panel. The testing and data analysis were completed on September 2, 2009.

This report must not be reproduced except in full with the approval of Stork Twin City Testing Corporation. The data in this report relates only to the items tested.

Stork Twin City Testing Corporation has been accredited by the U.S. Department of Commerce and the National Institute of Standards and Technology (NIST, formerly NBS) under their National Voluntary Laboratory Accreditation Program (NVLAP) for conducting ASTM E90 test procedure. This report may not be used to claim product endorsement by NVLAP, NIST or any agency of the U.S. Government.

SUMMARY OF RESULTS:**Sound Transmission Class (STC)**

<i>Sound Transmission Class (STC) Test</i>				Test Results		
Test #	Sample Identification	Weight (lbs)	Weight (psf)	STC	Def.	OITC
1	Ledge Stone 6" Thick Concrete Panel with Stone Facing	1205	60.3	50	22	45

Refer to **TEST DATA** on page 4 for additional test results.

SPECIMEN DESCRIPTION: (Also see "Test Results")

The specimen was identified by the client as Ledge Stone, a Concrete Panel manufactured by Fabcon, Inc. The panel measured 48" x 60" x 6" nominal thickness. The front and rear surfaces had a natural stone appearance.

**Concrete Panel in Test Wall**

PROJECT NUMBER: 30160-09-08173

PAGE: 3 of 4

DATE: September 4, 2009

TEST METHODS:**Sound Transmission Test**

ASTM:E90(04), "Laboratory Measurement of Airborne Sound Transmission of Building Partitions," was followed in every respect. The STC value was obtained by applying the Transmission Loss (TL) values to the STC reference contour of ASTM: E413(04), "Determination of Sound Transmission Class." The actual transmission loss at each frequency was calculated by the following equations:

$$TL = NR + 10 \log S - 10 \log A_2$$

where: TL = Transmission Loss (dB)
 NR = Noise Reduction (dB)
 S = Surface area common to both sides (sq. ft.)
 A₂ = Sound absorption of the receiving room with the sample in place (sabins)

OITC Procedure

ASTM:E1332(03), "Determination of Outdoor-Indoor Transmission Class", was followed in every respect. Basically, the OITC was calculated by using the sound transmission loss values in the 80 to 4000 Hz range as measured in accordance with ASTM E-90(04). These transmission loss data are then used to determine the A-weighted sound level reduction of the specimen for the reference source spectrum specified in Table 1 of ASTM E1332(03). The appropriate calculations were made to determine the OITC value. The source room has a volume of 2948-ft³ (83-m³) and the termination room has a volume of 5825-ft³ (165-m³).

The temperatures and relative humidity of the termination room met the requirements of the standard during and after the test. All frequencies met the requirements for 95% confidence established by the standard.

The panel was tested in Stork's Filler wall that was previously tested to a STC of 66.

TEST EQUIPMENT:

<u>Manufacturer</u>	<u>Model</u>	<u>Description</u>	<u>S/N</u>
Norwegian Electronics	NE830	Real Time Analyzer	10722
Brüel & Kjær	3923	Rotating Microphone Boom	815424
Norsonic (Source Rm)	1230	Pressure Condenser Microphone	26361
Brüel & Kjær (Term Rm)	4192	Pressure Condenser Microphone	2360314

REMARKS:

The samples will be retained for 14-days then discarded unless notified otherwise by client.

F:\Product\MMFILES\MNB\2009 REPORTS MNB\08173-Fabcon.doc

Information and statements in this report are derived from material, information and/or specifications furnished by the client and exclude any expressed or implied warranties as to the fitness of the material tested or analyzed for any particular purpose or use. This report is the confidential property of our client and may not be used for advertising purposes. This report shall not be reproduced except in full, without written approval of this laboratory. The recording of false, fictitious or fraudulent statements or entries on this document may be punished as a felony under Federal Statutes including Federal Law Title 18, Chapter 47

Stork Twin City Testing is an operating unit of Stork Materials Technology B.V., Amsterdam, The Netherlands, which is a member of the Stork group

Materials Technology

PROJECT NUMBER: 30160-09-08173

PAGE: 4 of 4

DATE: September 4, 2009

TEST RESULTS:

Filename

test #1

ASTM E90 - Laboratory Sound Transmission Class

Project Folder

08173 Fabcon

Client

Fabcon Inc.

Product

Ledge Stone

Model #

Quantity

1

Comment

Sample Size - Wt.

48.0 in x 60.0 in x 6" - 1205 lbs


Sample Description

Fabcon Inc. 4' x 5' x 6" Concrete Slab, Stone Pattern on both sides

Time Stamp

Thu, Sep 03, 2009 - 8:45 AM

F (Hz)	TLs - sample TL values (dB)		
	TLs	95% CI	def
80	38	2.9	-
100	37	1.1	-
125	39	1.3	0
160	40	1.5	0
200	42	0.8	0
250	41	0.5	2
315	40	0.4	6
400	41	0.4	8
500	46	0.4	4
630	49	0.3	2
800	52	0.2	0
1000	54	0.2	0
1250	57	0.2	0
1600	58	0.2	0
2000	61	0.2	0
2500	64	0.1	0
3150	67	0.2	0
4000	71	0.3	0

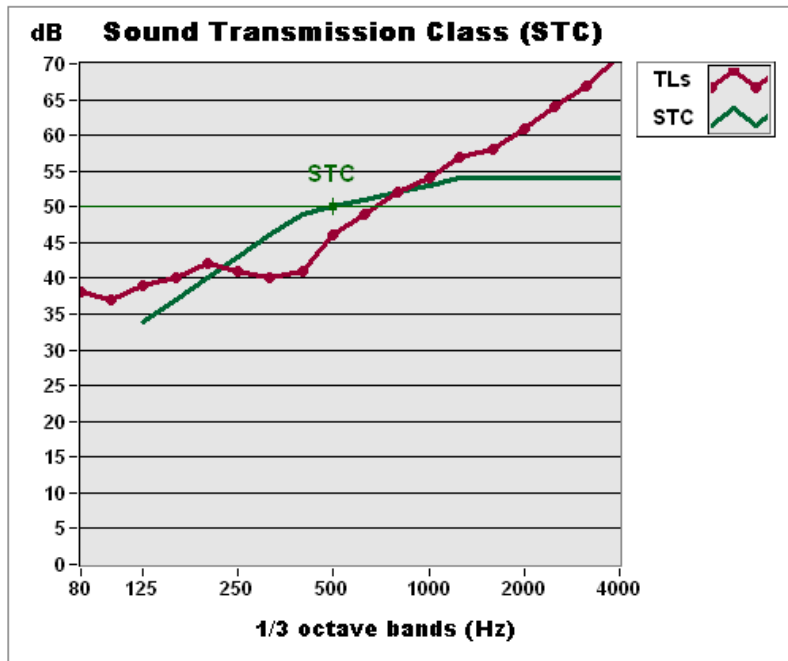

STC = 50 def: 22
OITC: 45

Temp (°C)

22.1

R.H. (%)

52

ATM (mbar)

1005

Information and statements in this report are derived from material, information and/or specifications furnished by the client and exclude any expressed or implied warranties as to the fitness of the material tested or analyzed for any particular purpose or use. This report is the confidential property of our client and may not be used for advertising purposes. This report shall not be reproduced except in full, without written approval of this laboratory. The recording of false, fictitious or fraudulent statements or entries on this document may be punished as a felony under Federal Statutes including Federal Law Title 18, Chapter 47.